

Tahoe Pedestal 7242SDP | Combination 43 Water & Air Massage

Product Number: TAC43J7236SDFSP-A 72" x 42" x 27"



STANDARD & OPTIONAL ACCESSORIES

JETS: 43 Total

- X 18 EZ Clean HTT Air Jets
- ⊕ 17 AccuMassage Back Jets
- ⊗ 2 AccuMassage Neck Pillow Jets
- ⊙ 4 Ultra Flow Water Jets
- ⊗ 2 Sole Soother Foot Jets
- A 10 EZ Clean HTT Leg Therapy Air Massage Floor Jets (optional)

PUMPS

- 2 - 3.25 Hydropower 3- speed Pump
- 1.25 Variable Speed Warm Air Pump
- Quiet Pad Anti-Vibration Mounted Pumps

HEATERS

- Stainless Steel Heater • Heated Air Pump
- Warm Back Rest Tubing Zone

CONTROLS

- Air Switch On/Off Control(s) for Hydro Pump and Chromatherapy Lighting • Automatic Purge & Dry Cycle Control

PURITY

- Hydro Clean Water Purity System • HydroCleanse

DRAINS & OVERFLOWS INFORMATION

- Overflow: Integral Slotted in Acrylic - no finishes available.
- Bath Drain: Pop up: Included- Polished Chrome or Brushed Nickel. Optional-White, Biscuit, Black, Polished Nickel, Oil Rubbed Bronze.
- In Floor Drain EZ Fast Connect (optional)

FAUCET INFORMATION

- Deck Mount or Floor mount (not included & no faucet holes drilled)
- Access Panel required for Deck faucet (optional)
- Floor mount verify spout distance

STANDARD ACCESSORIES

- Grab Bar(s) - 1 - White, Biscuit, Bone, Brushed Nickel, Polished Chrome, Oil Rubbed Bronze

- Chromatherapy Lighting • Deluxe Cushion Pillow • EZ Level Base • FDA Recipe Non-Toxic Food & Beverage Grade Plumbing (primarily) • 30 Point Quality Assurance Factory Test

ADDITIONAL INFORMATION

6 1/2" or more space required to access equipment panel. Tub may also need to be shifted or disconnected in some situations.

Access panel equipment design and location may vary based on model.

Your licensed qualified must water test and run all equipment before leaving your home to ensure proper operation and validate warranty.





TECHNICAL SPECIFICATIONS

- Side drain
- Pump Location: Standard

ELECTRICAL REQUIREMENTS

- (4) 115v 20AMP GFCI Circuits

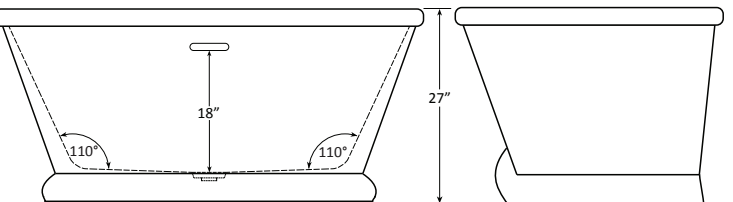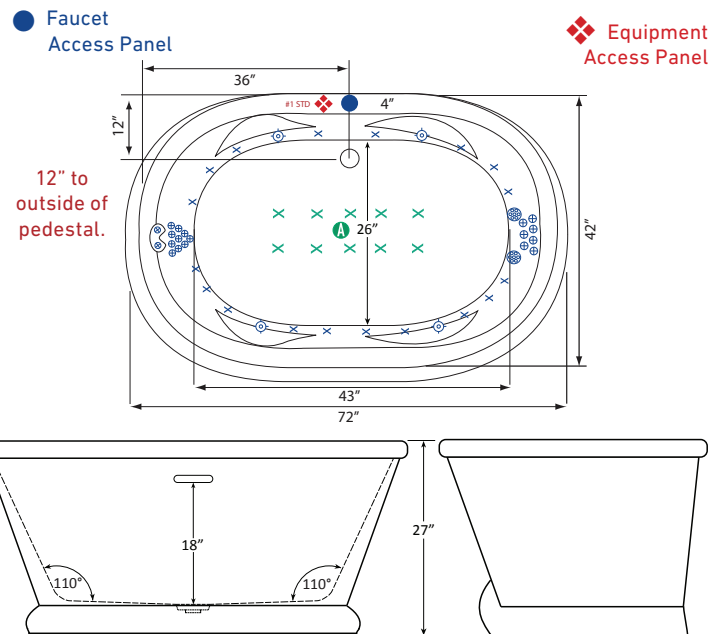

Decorative Pedestal is not on back side in order to accommodate equipment access. This side should be placed against wall.

Specifications and features are subject to change without notice and are + .25". All final measurements should be taken from tub on site.

HydroMassage Products LLC • 303-341-1845 • Fax: 303-341-1850 • www.hydromassageproducts.com

